

# Annexure C

## PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. 662

Dated 19/04/24

It is certified that an inspection team headed by Sanjay Kumar Lab. in charge

(Name of Officers with designation) from Ganga Global school PHED

inspected the .....

(Name & Address of the school) on 19.04.24 (date of inspection) and on the basis of

Water Test Report (Attached) bearing no. 4120 dated 19.04.2024

of Water Testing Lab, Begusarai (PHED Lab) certified that the

Ganga Global School (Name of school) has safe drinking water

facilities for the students and members of staff of the institution. School is also maintains the

hygienic sanitation condition in the school building & the campus as per norms prescribed by the

Central/ State/ U.T. Govt.

This certificate is valid till 6 Month

*(Handwritten Signature)*  
19/04/24

Executive Engineer

Signature with Seal: P.H. Division, Begusarai


Name: S. Prabhakar Kumar

Designation: Executive Engineer

Name & Address of the Office / Department: .....

P.H. Division, Begusarai  
Dr. P. Gupta Road, Ratanpur

To Ganga Global School  
Ratanpur, Begusarai  
(Name & Address of the Institution)

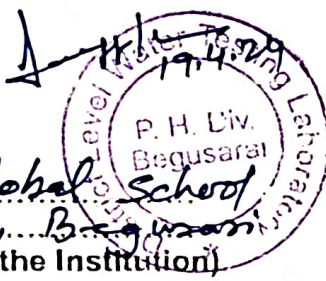

Note: The certificate is to be issued by authorized officer / PHED Lab / local bodies

**GOVERNMENT OF BIHAR**  
**P. H. Division, Begusarai**  
**DISTRICT LEVEL DRINKING WATER TESTING LABORATORY, BEGUSARAI.**

Report No. :- WQ/T/01/2007-4120. Dt. 19.04.2024  
 Ref Memo No. :- GGS/OASIS/24/4/1 Dt. 16.04.2024  
 Source of Sample :- Boring Treated Water.  
 Sample Collected By :- Office Staff

Date of Sampling - 16.04.2024  
 Sample received on -18.04.2024

**PHYSICO-CHEMICAL TEST REPORT**

Sl. No	SITE NAME	Physico - Chemical Parameters ppm (mg/l)															
		pH	Turbidity	Conductivity	TDS	Total Hardness	Calcium	Magnesium	Chloride	Alkalinity	Iron	Nitrate	Sulphate	Arsenic	Fluoride	Bacteriological	
1	Ganga Global School Ramzanpur, N.H. 31, Near Ganga Dairy Begusarai- 851129	7.5	1	501	326	274mg/l	61 mg/l	21 mg/l	69 mg/l	254 mg/l	0.33 mg/l	5.0 mg/l	22.0 mg/l	BDL	0.63mg/l	Negative	
Desirable Limit*		6.5-8.5	5 NTU	-	500mg/l	300mg/l	75mg/l	30mg/l	250mg/l	200mg/l	0.3mg/l	45mg/l	200mg/l	0.01mg/l	1.0mg/l	...	
Permissible Limit* in absence of alternate source		NR	NR	-	2000mg/l	600mg/l	200mg/l	100mg/l	1000mg/l	600mg/l	1.0mg/l	NR	400mg/l	NR	1.5mg/l	...	
Method of Testing Parameters		pH meteric	Nephelometric	Conductivity Meter	Conductivity Meter	EDTA Titration	EDTA Titration	EDTA Titration	Silver Nitrate Titration	Acid Titration	Phenonthroline Spectrophotometric	UV Spectrophotometric	UV Spectrophotometric	UV Spectrophotometric	UV Spectrophotometric	[H <sub>2</sub> S vial]	

- Note:-
- \*(1) Drinking Water Specification 2 nd Revision -IS:10500:2012
  - \*(2) Testing Methods are taken by APHA 20th
  - \*(3) NR = No Relaxation
  - \*(4) N.A. = Not available
  - \*(5) BDL = Below Detection Limit.

The result are reported based on materials received. Sample will be destroyed after 10 days from the date of issue of the certificate unless otherwise specified.

P.H.Division, Begusarai.

Chemist

*[Signature]*  
 19.4.24